


# INSPECTOR'S TEST ORIFICE AND SIGHT DRAIN

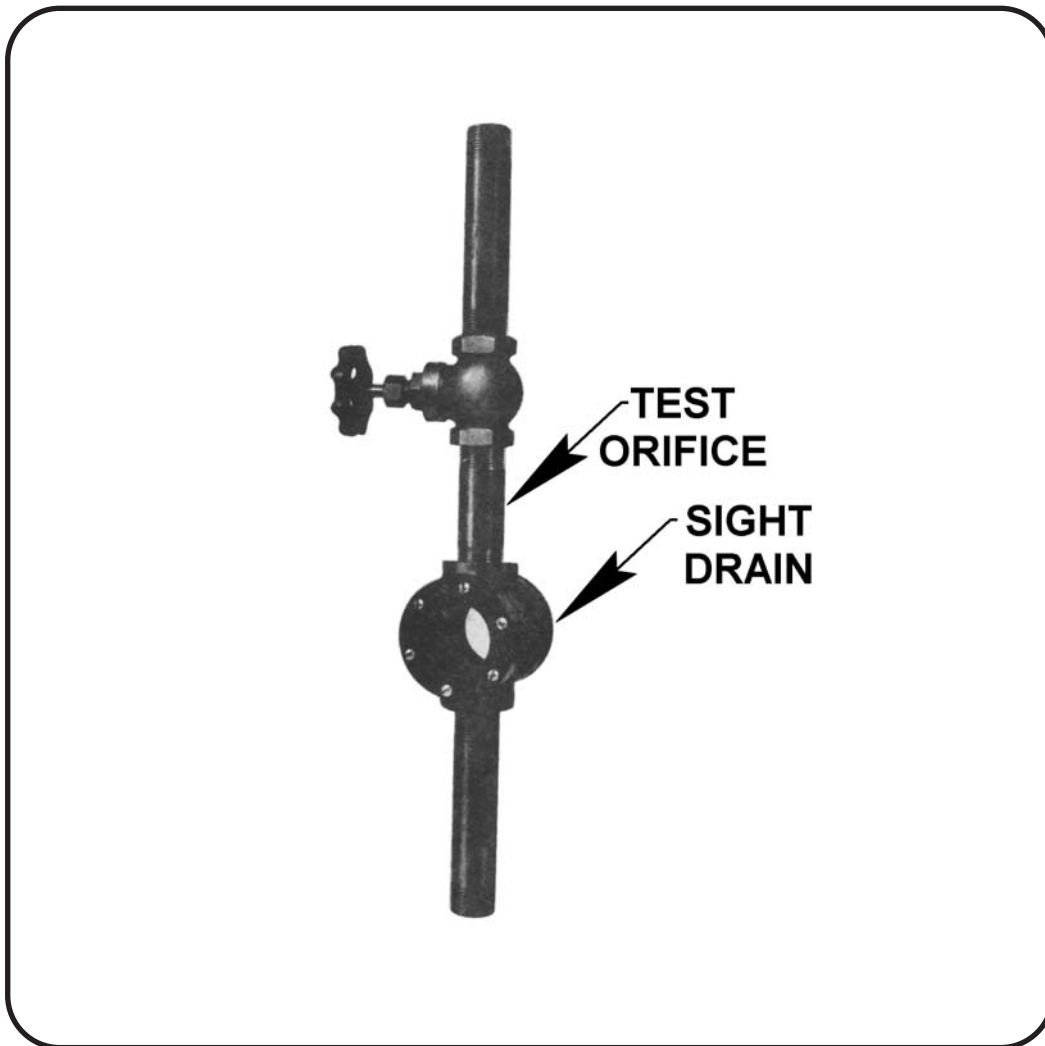

## DESCRIPTION & INSTALLATION

PROTECTION INCENDIE LTÉE

**VENUS**  
FIRE PROTECTION LTD

250 Laval street, Units 6 & 7  
Bromptonville, (Quebec) J0B 1H0  
Tél.: (819) 846-3444 - Fax: (819) 846-2717  
e-mail: venus@venus.ca

# INSPECTOR'S TEST ORIFICE

## DESCRIPTION AND INSTALLATION


The "Astra" Test Orifice is of all bronze construction - 1" pipe size - with a built in smooth orifice to provide a flow equivalent to one sprinkler head discharging and a convenient 3 inch length to allow for very easy installation.

The Test Orifice is intended for installation on the discharge side of the test valve and can be screwed into the inlet side of a "Astra" 1 inch Sight Drain.

**Specify Orifice Size :**

**A- 1/2" K=5.7**

**B- 17/32" K=8.0**

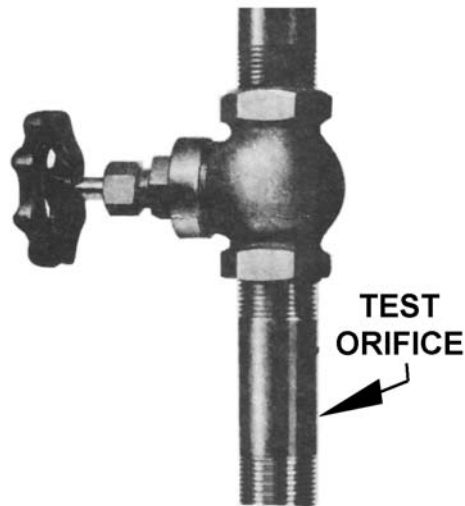

## SIGHT DRAIN

## DESCRIPTION AND INSTALLATION

The "Astra" Sight Drain is intended for use in Sprinkler Systems where the main drain discharge outlet is not readily visible. It is a requirement by all insurance inspection departments, that a Sight Drain be used in conjunction with a test orifice when the inspector's test connection is piped directly to a drain rather discharging outside into an open area. The "Astra" Sight Drains are available in 1" pipe size.



PROTECTION INCENDIE LTÉE

**VENUS**

FIRE PROTECTION LTD

MADE IN CANADA